


PLAN

** DEPTH OF RISER BLOCK

24' Span	NA
34' Span	4"
40' Span	7"

** x 22 1/2" x 16" Concrete Riser Block To Be Cast Monolithically With Cap.

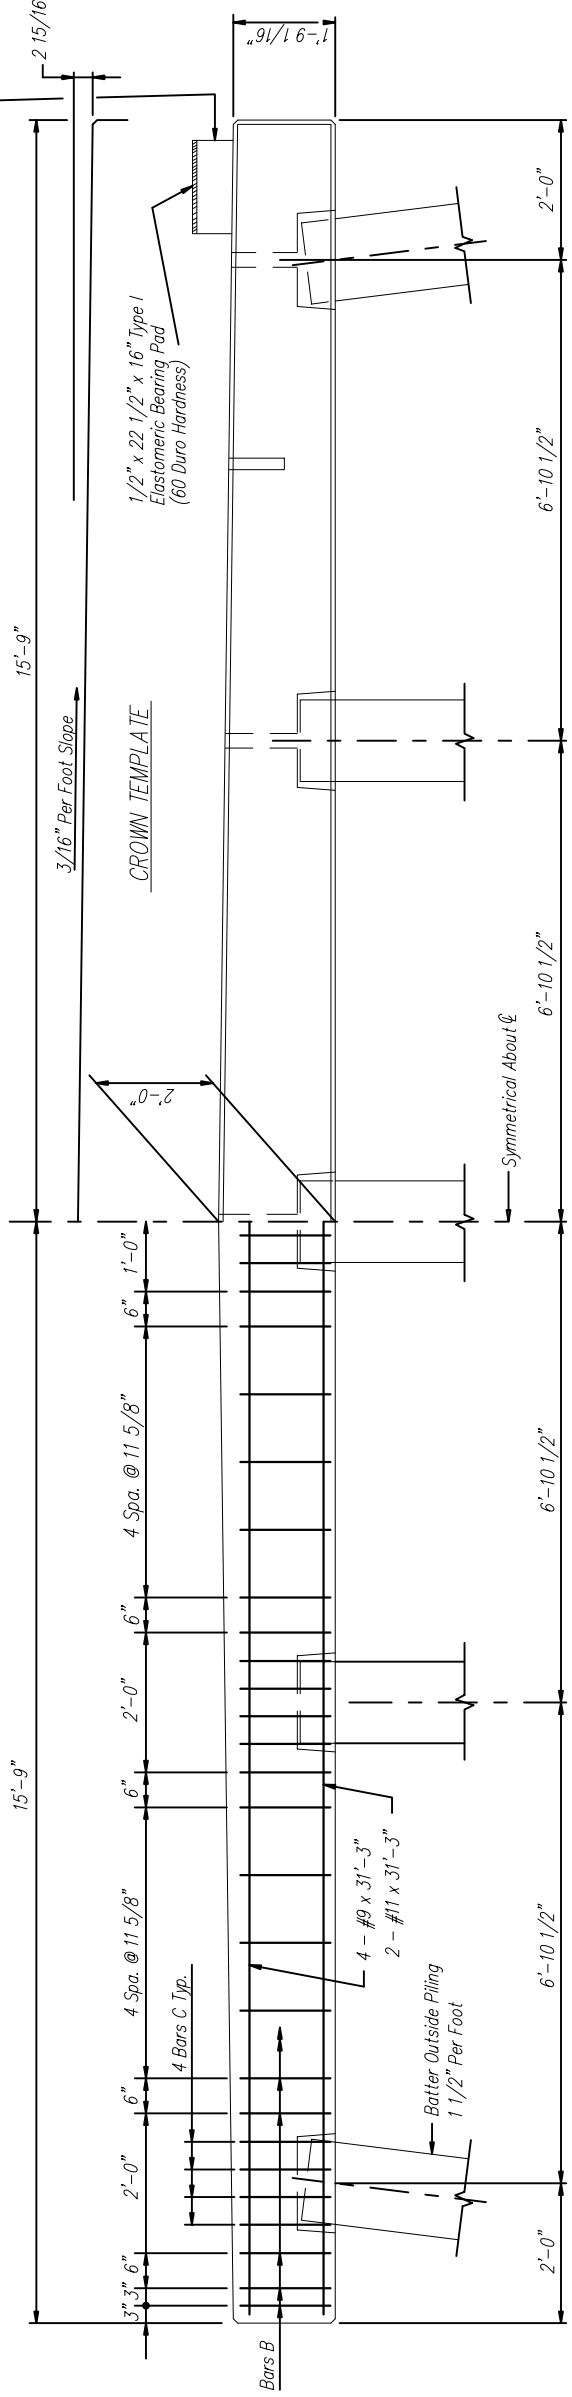


ELEVATION

*** PREFORMED EXP. JT. FILLER

24' Span	1/4" x 16" x 28'
34' Span	1/4" x 20" x 28'
40' Span	1/4" x 23" x 28'


1/4" x 28'-0" Preformed Expansion Joint Filler, AASHTO M-213 or Equal, Seal Joint in Accordance With ASTM D 5893-96

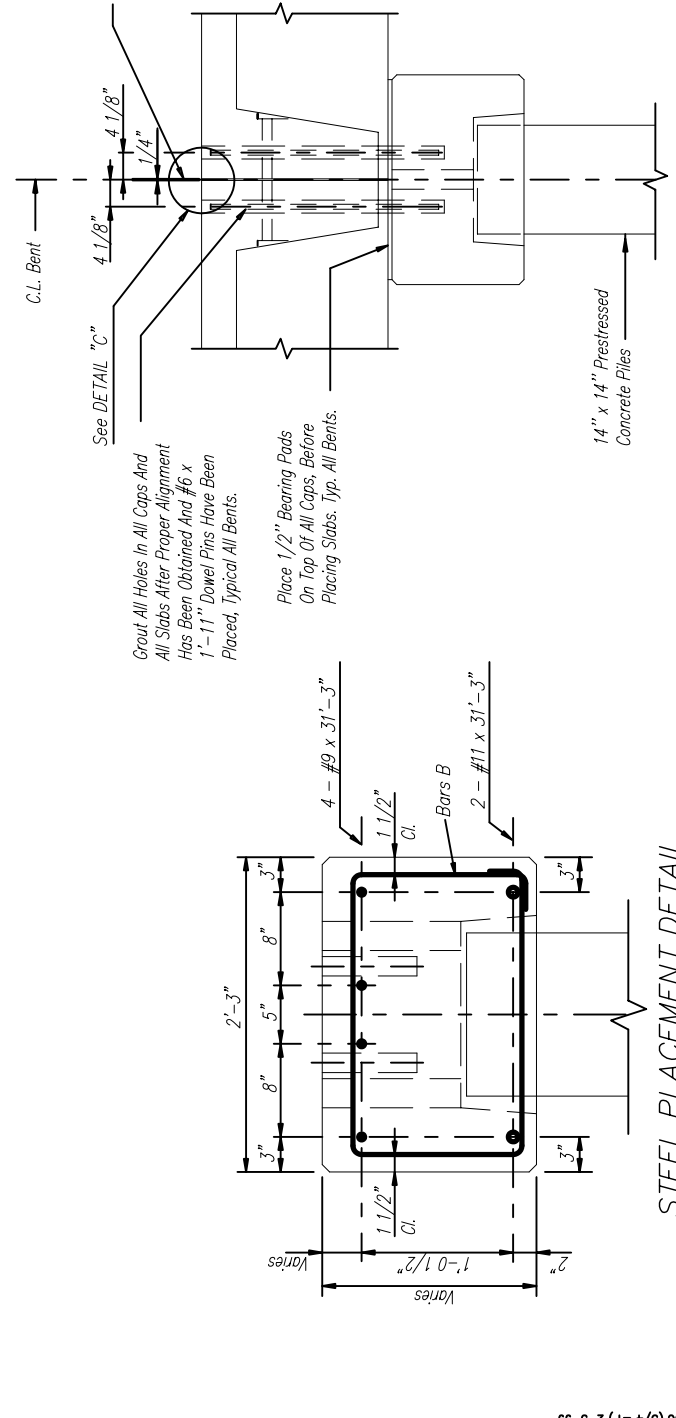

STEEL PLACEMENT DETAIL

TYPICAL INTERMEDIATE SECTION

* A 1/2" x 8" x 1'-10 1/2" Elastomeric Bearing, Type I Shall Be Used Under The Outside Legs Of The Exterior Channels.

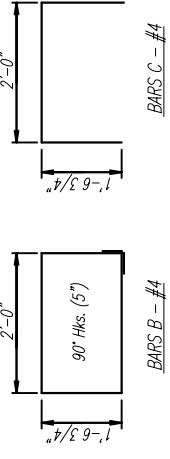

BAR BENDING DETAILS

Dimensions Are Out To Out

GENERAL NOTES:

SPECIFICATIONS:
 AASHTO STANDARD SPECIFICATIONS FOR HIGHWAY BRIDGES
 AASHTO STANDARD SPECIFICATIONS FOR TRANSPORTATION MATERIALS
 AMERICAN SOCIETY FOR TESTING AND MATERIALS
 AMERICAN INSTITUTE OF STEEL CONSTRUCTION
DESIGN LOADING: A.A.S.H.T.O. HS 20-44
CONCRETE: CONCRETE FOR SUBSTRUCTURE UNITS SHALL CONFORM TO AASHTO CLASS A. MINIMUM 28 DAY COMPRESSIVE STRENGTH SHALL BE 3000 PSI. ALL EXPOSED CORNERS TO BE CHAMFERED 3/4" BY 45° UNLESS OTHERWISE NOTED. ALL OTHER CORNERS ARE TO BE ROUNDED TO A 1/4" RADIUS. CONCRETE WILL NOT BE PAID FOR DIRECTLY, BUT WILL BE CONSIDERED AS SUBSIDIARY TO THE ITEM PRECAST CAP UNIT.
REINFORCING STEEL: ALL REINFORCING STEEL SHALL BE GRADE 60 BILLET STEEL MEETING THE REQUIREMENTS OF AASHTO M31 OR ASTM A615. ALL REINFORCING STEEL SHALL BE ACCURATELY LOCATED IN THE FORMS AND PROPER CLEARANCES MAINTAINED WITH STAINLESS STEEL OR RUBBER TIPPED CHAIRS. REINFORCING DIMENSIONS ARE CENTER TO CENTER UNLESS OTHERWISE NOTED ON PLANS. THE ABOVE STEEL WILL NOT BE PAID FOR DIRECTLY, BUT WILL BE CONSIDERED AS SUBSIDIARY TO THE ITEM PRECAST CONCRETE CAP UNIT.
PILING: ALL PILING SHALL BE 14" x 14" PRESTRESSED CONCRETE AS PER SECTION 4.5.20 OF THE CURRENT EDITION OF AASHTO STANDARD SPECIFICATIONS FOR HIGHWAY BRIDGES, DIVISION 1. PILE DESIGN LOADING 40 TONS (H20-44).
GROUT: EPOXY GROUT FOR CAPS TO PILING CONNECTION SHALL BE COMPOSED OF ONE (1) PART EPOXY (BINDER) AND THREE (3) PARTS DRY SILICA SAND. (BAGGED 1 CU. FT. PER BAG) MEASURED BY VOLUME. IT SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 5,000 p.s.i. IN TWELVE (12) HOURS. CONTRACTOR SHALL SUBMIT METHOD OF SAMPLING AND TESTING TO VERIFY STRENGTH REQUIREMENT AS REQUIRED BY THE ENGINEER OF RECORD PRIOR TO GROUTING CAPS.

TOLERANCES: A DEVIATION OF MORE THAN 1/8" MAY BE CAUSE FOR REJECTION OF THE UNIT.
DESIGN DATA: A.A.S.H.T.O. 1992 & INTERIM fs = 24,000 p.s.i.; fc = 1,200 p.s.i.; n=10
BID ITEM:
 _____ ELASTOMERIC BEARINGS TYPE I - Per Each
 _____ PRECAST CONCRETE INTERMEDIATE CAP, 2'-3" WIDE BY 2'-0" DEEP BY 31'-6" LONG - Per Each.

CBE CONEUCUH BRIDGE & ENGINEERING, LLC
 P. O. Box 129
 Troy, Alabama 36081
 249 County Rd. 2227
 Troy, Alabama 36079
 334-566-7422

DATE: 7/24/03

STANDARD DWG. NO. PCB-2840 CP
 SHEET NO. 1 OF 1

PRECAST CONCRETE BENT CAP
 FOR USE WITH 14" X 14" CONCRETE PILING
 AND 24', 34' OR 40' PRECAST CONCRETE
 BRIDGE SLABS -- 28 FT. CLEAR ROADWAY